	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	1/11
		Date:	2023-02-01

## Product Technical Document

Customer	
Model	YL-W51100
Document number	YL-WS-51100-0118
Version	A0
Date	2023-02-01

Prepared By/Date	Checked By/Date	Approved By/Date
Andy Li	Robert Zhen	Shy Liu

Customer Signature	Prepared By/Date	Checked By/Date	Approved By/Date
	Company Name:		
	Company Stamp:		

**Contact information:**


Shenzhen Yilink New Energy Technology Co., Ltd.

Add: Building A, Zhengzhong Times Square, Longgang District, Shenzhen , P.R.China

Tel:+86 755 28684503

Email: info@Yilink-energy.com

Website: [www.Yilink-energy.com](http://www.Yilink-energy.com)

	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	2/11
		Date:	2023-02-01

**Copyright ©2023 YILINK NEW ENERGY TECHNOLOGY CO., LTD. All rights reserved.**

All information in this document is subject to copyright and other intellectual property rights of YILINK and its licensors, No part of this document may be reproduced or transmitted in any form or by any means without prior written consent of YILINK NEW ENERGY TECHNOLOGY CO., LTD.


**NOTICE**

The information in this document is subject to change without notice, The latest information please contact [info@yilink-energy.com](mailto:info@yilink-energy.com) for assistance.

Every effort has been made in the preparation of this document to ensure accuracy of the contents, but all statements, information, and recommendations in this document do not constitute a warranty of any kind, express or implied.

**Errors or omissions**


You are welcome to contact with us if any inaccuracies or omissions in this specifications, please send an email to: [info@yilink-energy.com](mailto:info@yilink-energy.com). Thank you for helping us make our product better.

	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	3/11
		Date:	2023-02-01

# CONTENTS

- 1.Introduction**
  - 1.1Purpose of writing.....5
  - 1.2Reference standard.....5
- 2.Main Parameters**
- 3.Battery Management System**
- 4.Case Structure of Battery Pack**
  - 4.1Appearance.....8
  - 4.2Structure size and outline drawing.....8
  - 4.3All panel interface definitions.....8
- 5.Packaging of Battery Pack**
- 6.Storage,Transportation And Maintenance**
  - 6.1Storage.....10
  - 6.2Transportation.....10
  - 6.3Maintenance
- 7.Safety Instructions**
  - 7.1Danger.....11
  - 7.2Caution.....11



	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	5/11
		Date:	2023-02-01

## 1. Introduction


This article mainly describes the detailed technical requirements of the 51.2V100Ah liFePO4 battery pack supplied by YILINK, and clarifies various interface definitions, Please read the specification carefully before operations and please abide by relevant industrial safety regulations, YILINK will not be responsible for any damage to the product due to improper operations or use under conditions that are not prescribed in the specification.

### 1.1 Purpose of writing

This document provides the parameters of the 51.2V100Ah liFePO4 battery pack supplied by YILINK, and describes in detail how the product works, Facilitate the design, manufacture and inspection of this product by relevant personnel.

### 1.2 Reference standard


- 1.2.1 GB/T 36276-2018 (lithium ion battery for electrical energy storage)
- 1.2.2 IEC62619-2017 (Secondary cells and batteries containing alkaline or other non-acid electrolytes – Safety requirements for secondary lithium cells and batteries, for use in industrial applications)
- 1.2.3 UN38.3 (Recommendations on the Transport of Dangerous Goods: Manual of Tests and Criteria)

	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	6/11
		Date:	2023-02-01

## 2. Battery Pack Parameters

### Battery Pack Specification

No.	Items	General Parameter		Remark
1	Combination method	16S		
2	Nominal Voltage	51.2V		
3	Rated Capacity	Typical	100Ah	
		Minimum	100Ah	
4	Energy	5120Wh		
5	Factory Voltage	51.5~54.4V		Mean Operation Voltage
6	Voltage at end of Discharge	40~44.8V		Discharge Cut-off Voltage
7	Voltage at end of Charge	56~58.4V		Charge Cut-off Voltage
8	Standard charge	Constant Current 20A Constant Voltage see No.7 0.02CA cut-off		Charge time : Approx 5~6 h
9	Charge current limit module	20A		BMS Limited (Charge current is $\geq 100A$ to open the current Limit)
10	Standard discharge	Constant current: 20A end voltage see NO.6		
11	Maximum Continuous Charge Current	100A		$50^{\circ}C \geq T \geq 5^{\circ}C$
12	Maximum Continuous Discharge Current	100A		$55^{\circ}C \geq T \geq 0^{\circ}C$
13	Operation Temperature Range	Charge: $0 \sim 55^{\circ}C$		60 $\pm$ 25%R.H. No matter what mode the battery is in, once the temperature is found to exceed the absolute temperature range, stop charging or discharging immediately
		Discharge: $-20 \sim 60^{\circ}C$		
14	Storage Temperature Range	Less than 6 months: $-10 \sim 35^{\circ}C$		60 $\pm$ 25%R.H. at the shipment state
		Less than 3 months: $-10 \sim 45^{\circ}C$		
		Less than 1 months: $-20 \sim 55^{\circ}C$		
15	Dimensions(W*D*H)	480*520*167mm		Include case
16	Net Weight	52Kg		Include case
17	Internal Impedance	$\leq 40m\Omega$		Internal resistance measured at AC 1KHz; after 50% charge. The measure must uses the new batteries that within one week after shipment and cycles less than 5 times.


	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	7/11
		Date:	2023-02-01

### 3. Battery Management System

The BMS is designed for 16 series lithium battery.

The BMS have all functions which are :

Function		
Alarm	Cell over-charge voltage	Cell charge low temperature
	Cell over-discharge voltage	Cell charge over temperature
	Pack over-charge voltage	Cell discharge low temperature
	Pack over-discharge voltage	Cell discharge over temperature
	Over-current charge	Environment low temperature
	Over-current discharge	Environment over temperature
	Mos over temperature	
Protection	Cell over-charge voltage	Cell charge over temperature
	Cell over-discharge voltage	Cell discharge low temperature
	Pack over-charge voltage	Cell discharge over temperature
	Pack over-discharge voltage	Environment low temperature
	Over-current charge	Environment over temperature
	Over-current discharge	Short circuit
	Mos over temperature	Fault
	Cell charge low temperature	
Others	Cell balance function	
	Communicate function	
	Total capacity function	
	Storage history function	
	Current limiting function	
	Dry contact function	


	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	8/11
		Date:	2023-02-01

#### 4. Battery Pack Structure


##### 4.1 Appearance

There shall be no such defect as scratch, bur and other mechanical scratch, and the connector should be no rust dirt,The structure and dimensions see attached drawing of the battery.


##### 4.2 Structure size and outline drawing

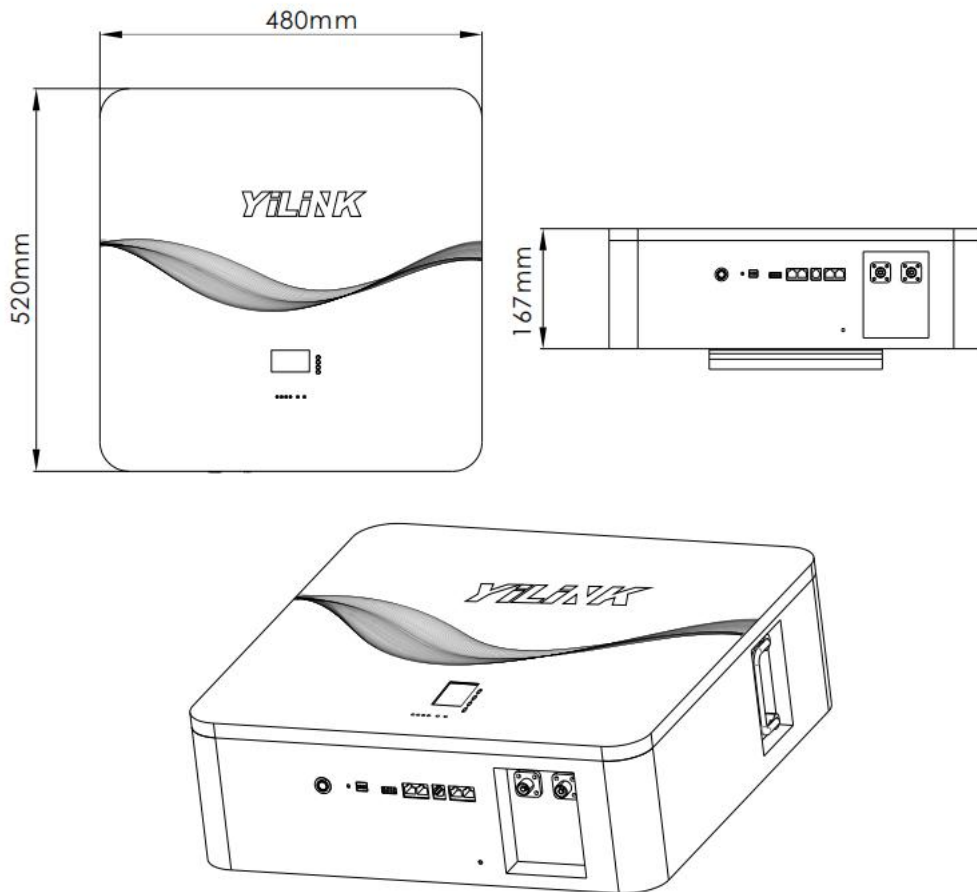




	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	10/11
		Date:	2023-02-01

### 4.3 Panel interface definitions

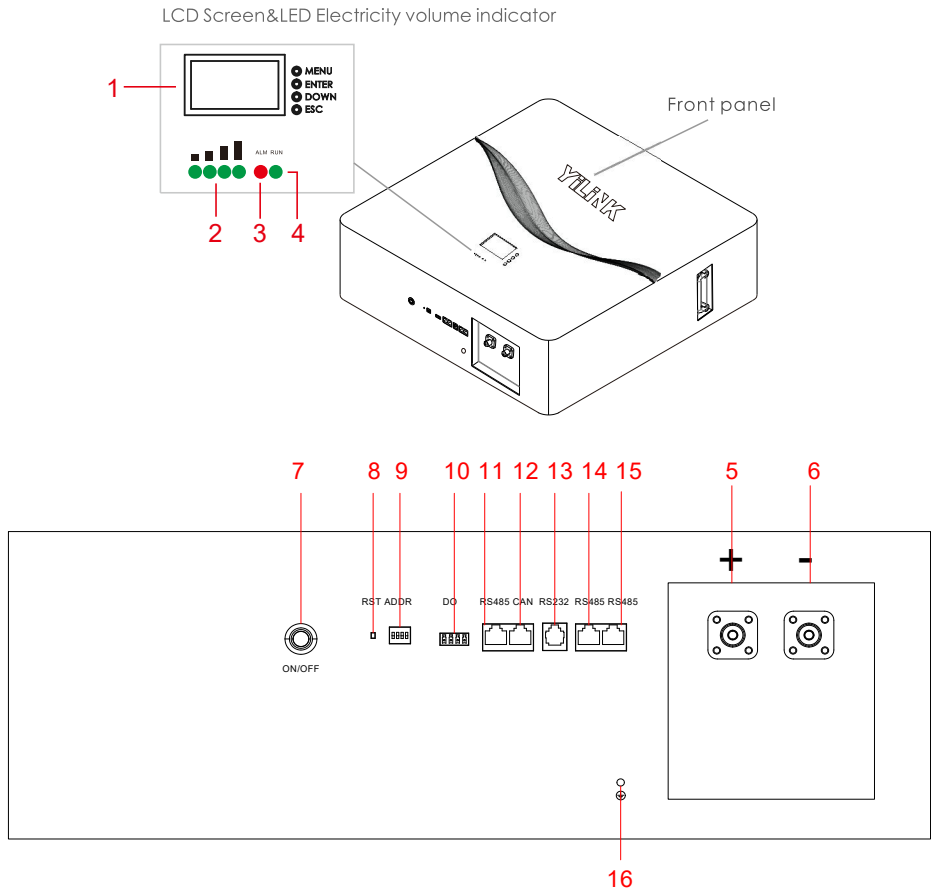


No.	Items	Description
1	LCD Screen	Display the battery's data
2	Capacity volume indicator	Display the battery's capacity.
3	ALM alarm indicator light	Red-trouble-light on.
4	Working indicator light	Display state information.
5	+ Power terminal	Power cable terminals: one connect to equipment, the other one paralleling to other battery module for capacity expanding.
6	- Power terminal	
7	Power Switch	To turn ON/OFF while battery.
8	Reset Key	Sleep /Activation /Reset.

	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	10/11
		Date:	2023-02-01

9	ADS Dialer	4 ADD switches, to definite different address code for each battery module when multiple modules are cascaded, up to 15 addresses.
10	Dry Contact Terminal	1/2 Normally open, closed during fault protection; 3/4 Normally open, closed when a low battery alarm.
11	RS485	RJ45 Port,used to connect to the inverter's RS485 port;
12	CAN	RJ45 Port,used to connect to the inverter's CAN port.
13	RS232	RJ11 Port,used battery condition monitoring or manufacturer to debug or service.
14/15	RS485	RJ45 Port,used communication in parallel, and for battery condition monitoring or manufacturer to debug.
16	Grounding Point	Safety

## 5. Packaging of Battery Pack

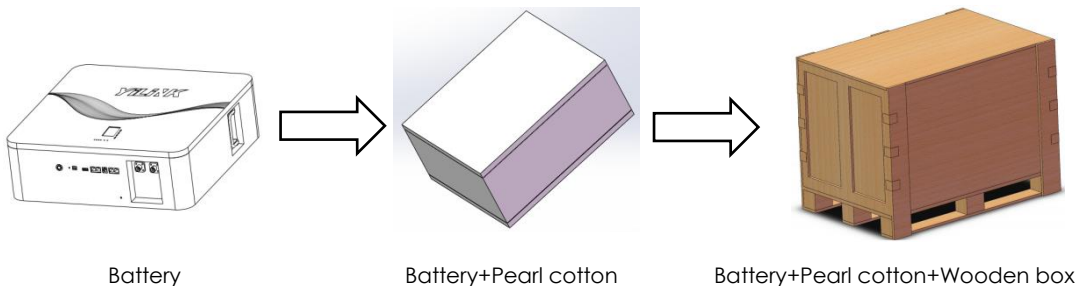


## 6. Storage,Transportation And Maintenance

### 6.1 Storage

When the battery pack needs to be stored for a long time, please charge the battery pack to not less than 60% SOC,Place in a dry,ventilated place,and circulate once every three months,The battery pack should be stored in a clean, dry and ventilated place,Avoid contact with corrosive substances and keep away from fire and heat sources.

### 6.2 Transportation

The battery pack should be packed and transported,During transport, it should be protected from severe vibration, impact or squeeze, and protected from sun and rain,It can be transported by vehicles,trains, ships, and other means of transportation.

	Technical Document	Document number:	YL-WS-51100-0118
		Version:	A0
	Model:YL-W51100	Pages:	11/11
		Date:	2023-02-01

### 6.3 Maintenance

- a) When the battery pack is stored, it should be stored in not less than 60%SOC;
- b) When the battery pack is not used for a long time, it is recommended to charge it once every three months ;
- c) During the maintenance process, please do not install or remove the battery by yourself, otherwise it will cause the performance of the battery to decrease;

## 7. SAFETY INSTRUCTIONS

### 7.1 Danger

- Do not immerse the battery in water or allow it to get wet.
- Do not use or store the battery near sources of heat such as a fire or heater.
- Do not use any chargers other than those recommended by YILINK.
- Do not reverse the positive(+) and negative(-) terminals.
- Do not connect the battery directly to wall outlets or car cigarette-lighter sockets.
- Do not put the battery into a fire or apply direct heat to it.
- Do not short-circuit the battery by connecting wires or other metal objects to the positive(+) and negative(-) terminals.
- Do not pierce the battery casing with a nail or other sharp object, break it open with a hammer, or step on it.
- Do not strike, throw or subject the battery to sever physical shock.
- Do not directly solder the battery terminals.
- Do not attempt to disassemble or modify the battery in any way.
- Do not place the battery in a microwave oven or pressurized container.
- Do not use the battery in combination with primary batteries(such as dry-cell batteries) or batteries of different capacity, type or brand.
- Do not use the battery if it gives off an odor, generates heat, becomes discolored or deformed,or appears abnormal in any way, If the battery is in use or being recharged, remove it from the device or charger immediately and discontinue use.

### 7.2 Caution

- Do not use or store the battery where is exposed to extremely hot, such as under window of a car in direct sunlight in a hot day,Otherwise, the battery may be overheated,This can also reduce battery performance and/or shorten service life.
- If the battery leaks and electrolyte gets in your eyes, do not rub them. Instead, rinse them with clean running water and immediately seek medical attention,If not dealt with in time, electrolyte can cause eye injury.